


NOTES

- TRIPLEX SOFTENER, METER INITIATED, DEMAND RECALL SYSTEM, UNITS BROUGHT ON LINE BASED ON FLOW-RATE.
- SOFTENER EQUIPPED WITH 1.25" TAIL FITTINGS WITH MAIN CONTROLLER.
- MAXIMUM RECOMMENDED SYSTEM PRESSURE IS 100 PSI (690 kPa) AND MINIMUM INLET PRESSURE IS 40 PSI.
- MAXIMUM RECOMMENDED SYSTEM TEMPERATURE IS 100 °F (38 °C). REQUIRES 120 VOLT, 1 PHASE, 60 Hz ELECTRICAL POWER.
- ALL EXTERNAL PIPING, FITTINGS, AND VALVES SHOWN BY BROKEN LINES ARE SUPPLIED BY OTHERS.
- MINERAL TANKS AND MEDIA ARE NSF APPROVED.
- DUE TO SLIGHT EXPANSION AND CONTRACTION OF MINERAL TANK, PIPING MUST BE DESIGNED TO ALLOW SOME MOVEMENT. AS WELL AS BE PROTECTED FROM VACUUM. FLEX CONNECTORS AND A VACUUM BREAKER MAY BE REQUIRED. FAILURE TO INSTALL EITHER OF THEM OR IMPROPERLY INSTALL THEM MAY VOID THE WARRANTY.
- SYSTEM MUST BE INSTALLED TO COMPLY WITH ALL FEDERAL, STATE, PROVINCIAL, AND LOCAL CODES.
- FLOOR DRAINS MUST BE SIZED TO CARRY THE MAX. LISTED FLOW TO DRAIN.
- REFER TO THE INSTALLATION AND OPERATION MANUAL FOR FURTHER DETAILS.
- USE PROPER UNION OR FLANGE FOR THE PIPE CONNECTION TO VALVE FOR EASY MAINTENANCE.
- ALSO AVAILABLE IN 1" AND 1.5" PIPING CONNECTION.

FLOW RATE PER UNIT

Model (Triplex)	Capacity		Resin		Salt Usage		Critical Flow	95 - 1.25"			Dimensions		Drain Pipe Size	Installation			Shipping Weight	Operating Weight
	@6 lbs/ft <sup>3</sup>	10 lbs/ft <sup>3</sup>	ft <sup>3</sup>	m <sup>3</sup>	@6 lbs/ft <sup>3</sup>	10 lbs/ft <sup>3</sup>		@ 15 PSI	@ 25 PSI	To Drain	Mineral Tank	Brine Tank		Height	Depth	width		
	10 lbs/ft <sup>3</sup>	10 lbs/ft <sup>3</sup>	ft <sup>3</sup>	m <sup>3</sup>	lbs	lbs	USGPM	USGPM	USGPM	in	in	in	in	in	in	in	lbs	lbs
95MTS	66000		3		18	30	15	25	35	5	14 x 65	24 x 37	1"	77	30	141	885	4,485
90-1.25"	81000		0.08		8.18	13.64	0.95	1.58	2.21	0.32	356 x 1651	610 x 940	25	1,956	762	3,581	402	2,035
95MTS	88000		4		24	40	20	27	38	7	16 x 65	24 x 37	1"	77	30	147	1,155	5,055
120-1.25"	108000		0.11		10.91	18.18	1.26	1.70	2.40	0.44	403 x 1651	610 x 940	25	1,956	762	3,734	524	2,294
95MTS	110000		5		30	50	25	32	43	8	18 x 65	24 x 37	1"	77	30	153	1,434	5,634
150-1.25"	135000		0.14		13.64	22.73	1.58	2.02	2.71	0.51	475 x 1651	610 x 940	25	1,956	762	3,886	651	2,556
95MTS	132000		6		36	60	30	31	42	11	21 x 62	29 x 50	1"	80	35	177	1,695	7,995
180-1.25"	162000		0.17		16.36	27.27	1.89	1.96	2.65	0.69	533 x 1575	740 x 1275	25	2,032	889	4,496	769	3,627
95MTS	154000		7		42	70	31	31	42	11	21 x 62	29 x 50	1"	80	35	177	1,854	8,154
210-1.25"	189000		0.20		19.09	31.82	1.96	1.96	2.65	0.69	533 x 1575	740 x 1275	25	2,032	889	4,496	841	3,700
95MTS	176000		8		48	80	32	32	44	17	24 x 72	29 x 50	1"	88	35	186	2,073	9,273
240-1.25"	216000		0.23		21.82	36.36	2.02	2.02	2.78	1.07	610 x 1829	740 x 1275	25	2,235	889	4,724	941	4,207
95MTS	198000		9		54	90	32	32	44	17	24 x 72	33 x 53	1"	88	39	198	2,268	10,968
270-1.25"	243000		0.25		24.55	40.91	2.02	2.02	2.78	1.07	610 x 1829	840 x 1335	25	2,235	991	5,029	1,029	4,976
95MTS	220000		10		60	100	32	32	43	17	24 x 72	33 x 53	1"	88	39	198	2,427	11,127
300-1.25"	270000		0.28		27.27	45.45	2.02	2.02	2.71	1.07	610 x 1829	840 x 1335	25	2,235	991	5,029	1,101	5,049
95MTS	242000		11		66	110	31	31	42	17	24 x 72	33 x 53	1"	88	39	198	2,586	11,286
330-1.25"	297000		0.31		30.00	50.00	1.96	1.96	2.65	1.07	610 x 1829	840 x 1335	25	2,235	991	5,029	1,173	5,121

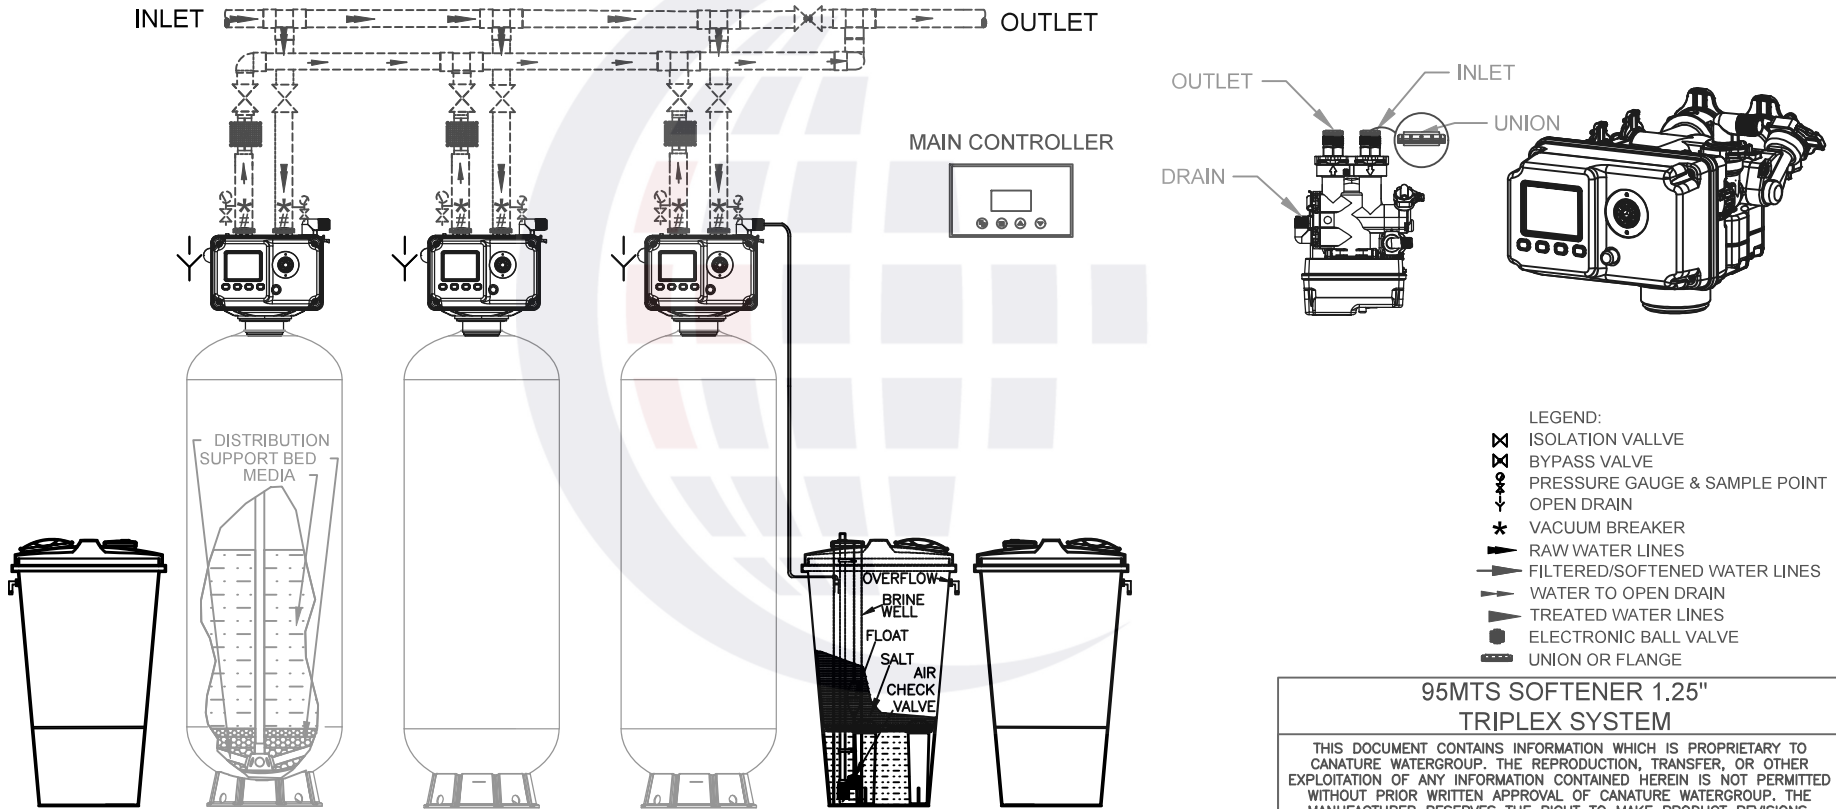

RAW WATER REGENERATION PIPING SHOWN



**95MTS SOFTENER 1.25"  
TRIPLEX SYSTEM**

THIS DOCUMENT CONTAINS INFORMATION WHICH IS PROPRIETARY TO CANATURE WATERGROUP. THE REPRODUCTION, TRANSFER, OR OTHER EXPLOITATION OF ANY INFORMATION CONTAINED HEREIN IS NOT PERMITTED WITHOUT PRIOR WRITTEN APPROVAL OF CANATURE WATERGROUP. THE MANUFACTURER RESERVES THE RIGHT TO MAKE PRODUCT REVISIONS, WHICH MAY DEVIATE FROM THE SPECIFICATIONS AND DESCRIPTIONS STATED HEREIN WITHOUT OBLIGATION TO CHANGE PREVIOUSLY MANUFACTURED PRODUCTS OR TO NOTE THE CHANGE.

Project \_\_\_\_\_ Date 10-26-2017 Rev \_\_\_\_\_  
Dwg # 95MTS1.25T 0