


Model (Quadraplex)	Max Service	Max Flow To	Pipe Size		Media	Mineral Tank		Installation			Shipping	Operating
	Flow Rate	Drain	Service	Drain	Per Tank	Diameter	Height	Height	Depth	Width	Weight	Weight
	USGPM	USGPM	in	in	CF	in	in	in	in	in	lbs	lbs
	l/s	l/s	mm	mm	m <sup>3</sup>	mm	mm	mm	mm	mm	kg	kg
95MTS BF14-1.25"	20 1.28	11 0.69	1.25" 32	1" 25	2.5 0.071	14 356	65 1651	79 2006.6	20 508	80 2032	1,228 557	2,828 1,283
95MTS BF16-1.25"	28 1.76	14 0.88	1.25" 32	1" 25	3.5 0.01	16 406	65 1651	79 2006.6	22 559	88 2236	1,464 664	3,464 1,572
95MTS BF18-1.25"	36 2.28	17 1.07	1.25" 32	1" 25	4.5 0.127	18 475	65 1651	79 2006.6	24 610	96 2440	1,864 846	4,264 1,935
95MTS BF21-1.25"	48 3.04	24 1.51	1.25" 32	1" 25	6 0.17	21 533	62 1575	77 1956	27 686	108 2744	2,348 1,065	5,548 2,517

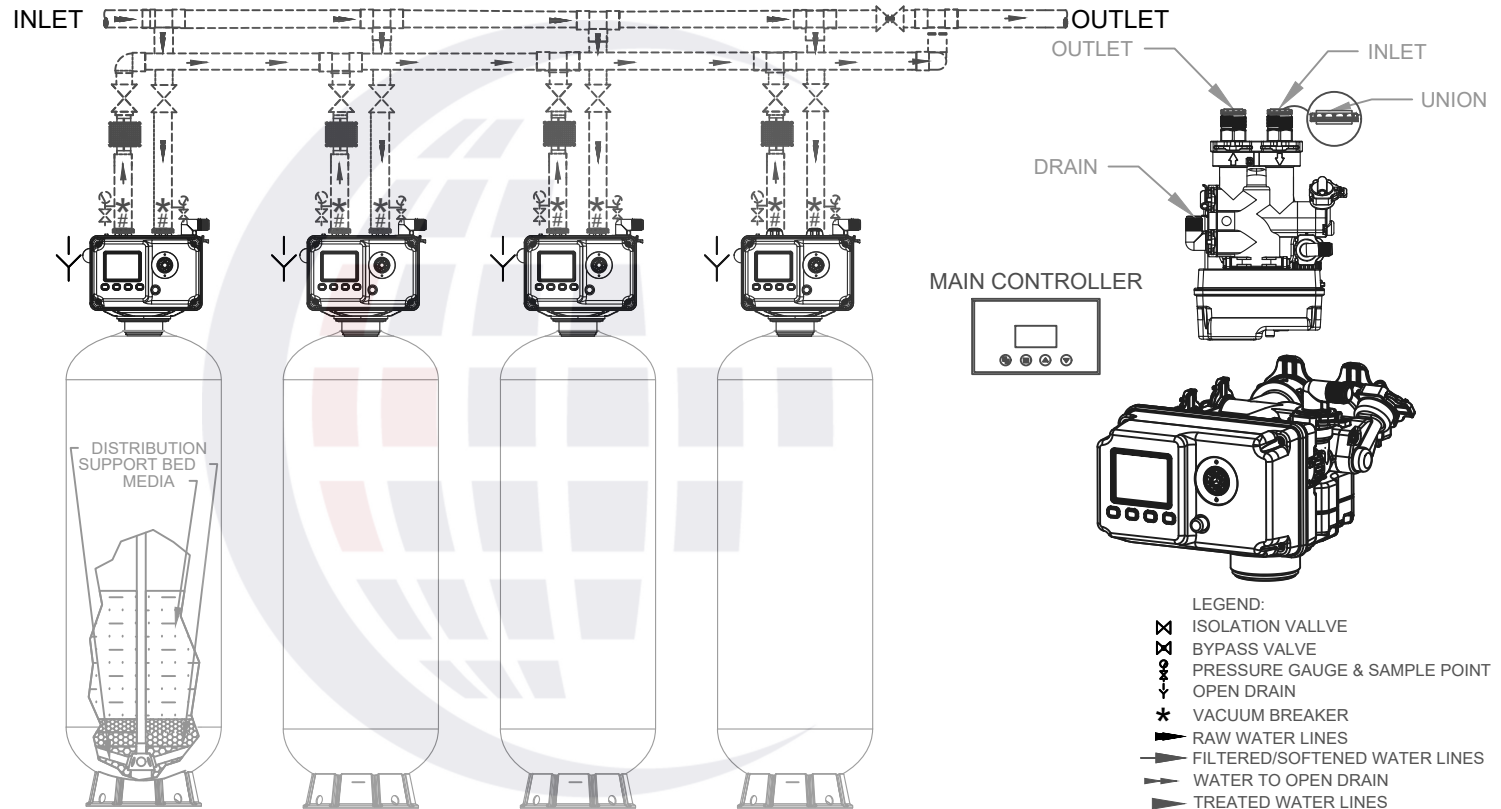

RAW WATER REGENERATION PIPING SHOWN

NOTES

- QUADRAPLEX FILTER, CALENDAR CLOCK INITIATED, MULTI-TANK SYSTEMS ARE SERIES REGENERATION.
- FILTER IS EQUIPPED WITH 1.25" VALVE ELECTRONIC BALL VALVE WITH MAIN ELECTRONIC CONTROLLER.
- MAXIMUM RECOMMENDED SYSTEM PRESSURE IS 100 PSI (690 kPa) AND MINIMUM INLET PRESSURE IS 40 PSI.
- MAXIMUM RECOMMENDED SYSTEM TEMPERATURE IS 100 °F (38 °C).
- REQUIRES 120 VOLT, 1 PHASE, 60 HZ ELECTRICAL POWER.
- ALL EXTERNAL PIPING, FITTINGS, AND VALVES SHOWN BY BROKEN LINES ARE SUPPLIED BY OTHERS.
- MINERAL TANKS AND MEDIA ARE NSF APPROVED.
- DUE TO SLIGHT EXPANSION AND CONTRACTION OF MINERAL TANK, PIPING MUST BE DESIGNED TO ALLOW SOME MOVEMENT. AS WELL AS BE PROTECTED FROM VACUUM. FLEX CONNECTORS AND A VACUUM BREAKER MAY BE REQUIRED. FAILURE TO INSTALL EITHER OF THEM OR IMPROPERLY INSTALL THEM MAY VOID THE WARRANTY.

- FLOOR DRAINS MUST BE SIZED TO CARRY THE MAX. LISTED FLOW TO DRAIN.
- REFER TO THE INSTALLATION AND OPERATION MANUAL FOR FURTHER DETAILS.
- USE PROPER UNION OR FLANGE FOR THE PIPE CONNECTION TO VALVE FOR EASY MAINTENANCE.
- SYSTEM MUST BE INSTALLED TO COMPLY WITH ALL FEDERAL, STATE, PROVINCIAL, & LOCAL CODES
- MEDIA BED CONSISTS OF NSF APPROVED BIRM MEDIA ON A GRADED SUPPORT BED.
- IF OPTIONAL AIR DRAW SYSTEM USED THE SYSTEM MUST BE DESIGNED SO THE HYDROCHARGER BANK DRAWS AIR CONTINUOUSLY.

95MTS BIRM FILTER  
1.25" QUADRAPLEX SYSTEM

THIS DOCUMENT CONTAINS INFORMATION WHICH IS PROPRIETARY TO CANATURE WATERGROUP. THE REPRODUCTION, TRANSFER, OR OTHER EXPLOITATION OF ANY INFORMATION CONTAINED HEREIN IS NOT PERMITTED WITHOUT PRIOR WRITTEN APPROVAL OF CANATURE WATERGROUP. THE MANUFACTURER RESERVES THE RIGHT TO MAKE PRODUCT REVISIONS, WHICH MAY DEVIATE FROM THE SPECIFICATIONS AND DESCRIPTIONS STATED HEREIN WITHOUT OBLIGATION TO CHANGE PREVIOUSLY MANUFACTURED PRODUCTS OR TO NOTE THE CHANGE.



Project _____	Date 10-18-2017	Rev _____
	Dwg # 95MTS BF1.25Q	0