
	Model (Duplex)	Typical	RO	Max Flow To	Pipe Size		Media	Mineral Tank		Installation			Shipping	Operating
		System Flow Rate		Drain	Service	Drain	Per Tank	Diameter	Height	Height	Depth	Width	Weight	Weight
		USGPM	USGPM	USGPM	in	in	CF	in	in	in	in	in	lbs	lbs
		I/s	I/s	I/s	mm	mm	m³	mm	mm	mm	mm	mm	kg	kg
	95MTS	20	16	14	1.25"	1"	2.65	14	65	79	20	40	826	1,626
	MM14-1.25"	1.26	1	0.88	32	25	0.075	356	1651	2006.6	508	1016	376	738
	95MTS	28	22	17	1.25"	1"	3.5	16	65	79	22	44	1,026	2,026
	MM16-1.25"	1.76	1.38	1.07	32	25	0.1	406	1651	2006.6	559	1118	466	919
	95MTS	34	26	21	1.25"	1"	4.4	18	65	79	24	48	1,302	2,502
	MM18-1.25"	2.142	1.638	1.32	32	25	0.125	475	1651	2006.6	610	1220	591	1,135



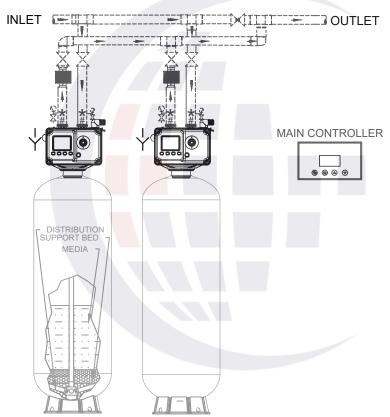


RAW WATER REGENERATION PIPING SHOWN

- REGENERATION. FILTER IS EQUIPPED WITH 1.25" VALVE ELECTRONIC BALL VALVE WITH MAIN
- ELECTRONIC CONTROLLER.
- MAXIMUM RECOMMENDED SYSTEM PRESSURE IS 100 PSI (690 kPa) AND MINIMUM -INLET PRESSURE IS 40 PSI.

DUPLEX FILTER, CALENDAR CLOCK INITIATED, MULTI-TANK SYSTEMS ARE SERIES

- MAXIMUM RECOMMENDED SYSTEM TEMPERATURE IS 100 °F (38 °C).
- REQUIRES 120 VOLT, 1 PHASE, 60 Hz ELECTRICAL POWER.
- ALL EXTERNAL PIPING, FITTINGS, AND VALVES SHOWN BY BROKEN LINES ARE SUPPLIED BY OTHERS.
- MINERAL TANKS AND MEDIA ARE NSF APPROVED.
- DUE TO SLIGHT EXPANSION AND CONTRACTION OF MINERAL TANK, PIPING MUST BE DESIGNED TO ALLOW SOME MOVEMENT. AS WELL AS BE PROTECTED FROM VACUUM. FLEX CONNECTORS AND A VACUUM BREAKER MAY BE REQUIRED. FAILURE TO INSTALL EITHER OF THEM OR IMPROPERLY INSTALL THEM MAY VOID THE WARRANTY.
- FLOOR DRAINS MUST BE SIZED TO CARRY THE MAX. LISTED FLOW TO DRAIN.
- REFER TO THE INSTALLATION AND OPERATION MANUAL FOR FURTHER DETAILS
- USE PROPER UNION OR FLANGE FOR THE PIPE CONNECTION TO VALVE FOR EASY MAINTENANCE.
- SYSTEM MUST BE INSTALLED TO COMPLY WITH ALL FEDERAL, STATE, PROVINCIAL, & LOCAL CODES,
- MEDIA BED CONSISTS OF NSF APPROVED ANTRAFILT, FINE FILTER SAND FINE & COARSE GARNET ON A GRADED SUPPORT BED.







LEGEND:

ISOLATION VALLVE

BYPASS VALVE

PRESSURE GAUGE & SAMPLE POINT

OPEN DRAIN

VACUUM BREAKER

RAW WATER LINES

► FILTERED/SOFTENED WATER LINES

→ WATER TO OPEN DRAIN

TREATED WATER LINES

ELECTRONIC BALL VALVE

UNION OR FLANGE

95MTS MULTIMEDIA FILTER 1.25" DUPLEX SYSTEM

THIS DOCUMENT CONTAINS INFORMATION WHICH IS PROPRIETARY TO CANATURE WATERGROUP. THE REPRODUCTION, TRANSFER, OR OTHER CANATURE WATERGROUP. THE REPRODUCTION, TRANSER, OR OTHER
EXPLOITATION OF ANY INFORMATION CONTAINED HEREIN IS NOT PERMITTED
WITHOUT PRIOR WRITTEN APPROVAL OF CANATURE WATERGROUP. THE
MANUFACTURER RESERVES THE RIGHT TO MAKE PRODUCT REVISIONS,
WHICH MAY DEVIATE FROM THE SPECIFICATIONS AND DESCRIPTIONS STATED
HEREIN WITHOUT OBLIGATION TO CHANGE PREVIOUSLY MANUFACTURED PRODUCTS OR TO NOTE THE CHANGE.

roject	Date 10-18-2017 F	Rev	
,	Dwg # 95MTS MM1.25D	0	