



- LEGEND:
- ISOLATION VALVE
 - BYPASS VALVE
 - PRESSURE GAUGE & SAMPLE POINT
 - OPEN DRAIN
 - VACUUM BREAKER
 - RAW WATER LINES
 - FILTERED WATER LINES
 - WATER TO OPEN DRAIN

STAGER
CONTROLLER



DBF Series Triplex Model	Max Service	Max Flow To Drain	Pipe Size		Media	Mineral Tank		Installation			Shipping Weight	Operating Weight
	Flow Rate		Service	Drain	Per Tank	Diameter	Height	Height	Depth	Width	lbs	lbs
	USGPM	USGPM	in	in	CF	in	in	in	in	in		
	I/s	I/s	mm	mm	(m ³)	mm	mm	mm	mm	mm		
DBF 30-2"	75.0	50	2"	2"	12.5	30	72	104	45	108	4,200	9,000
	4.7	3.15	50	50	0.35	762	1,829	2,642	1,143	2,743	1,906	4,083
DBF 36-2"	105.0	70	2"	2"	17.6	36	72	105	51	126	5,700	11,700
	6.6	4.41	50	50	0.50	914	1,829	2,667	1,295	3,200	2,586	5,309
DBF 42-3"	144.0	95	3"	3"	24.0	42	72	113	65	144	7,500	17,700
	9.1	5.985	75	75	0.68	1,067	1,829	2,870	1,651	3,658	3,403	8,031
DBF 48-3"	189.0	125	3"	3"	31.0	48	72	115	71	162	9,300	22,200
	11.9	7.875	75	75	0.88	1,219	1,829	2,921	1,803	4,115	4,220	10,073
DBF 63-4"	324.0	215	3"	4"	54.0	63	86	118	86	207	17,400	34,500
	20.4	13.545	75	100	1.53	1,600	2,184	2,997	2,184	5,258	7,895	15,653

Service flow rate based on 5 usgpm/ft² Hydrocharger (air induction) system if required sold separately.

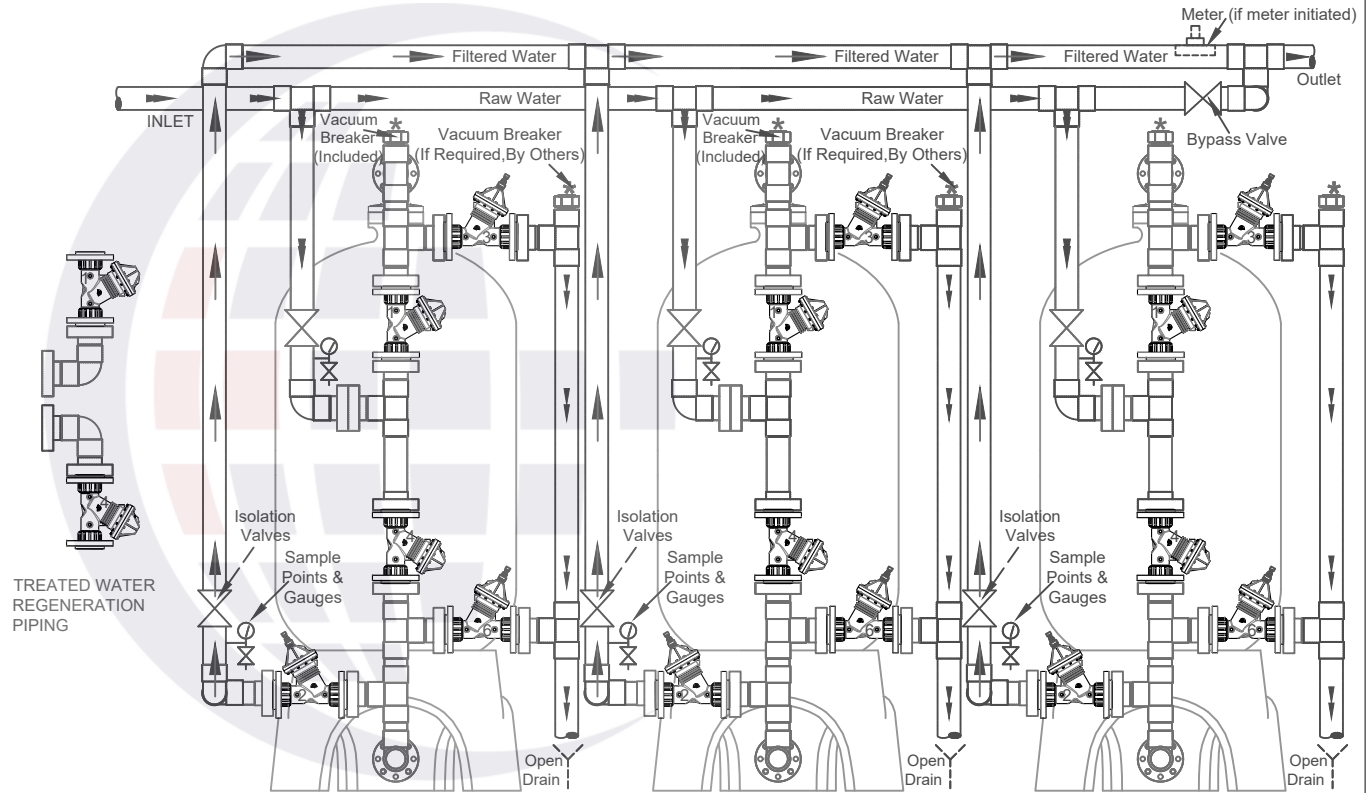

RAW WATER REGENERATION PIPING SHOWN

NOTES:

- MAXIMUM RECOMMENDED SYSTEM PRESSURE IS 100 PSIG (690 kPa).
- MAXIMUM RECOMMENDED SYSTEM TEMPERATURE IS 90° F (32°C).
- TANKS, AND MEDIA ARE NSF APPROVED. TRIPOD TANKS TO BE SECURELY ATTACHED TO THE FLOOR.
- ALL PIPING, FITTINGS, INTERCONNECTING PIPING, ISOLATION & SAMPLE VALVES AND GAUGES SHOWN BY BROKEN LINES ARE BY OTHERS
- SUPPLIED MANIFOLD IS SCH 80 PVC AND IS SUPPLIED WITH ONE VACUUM BREAKER. RECOMMENDED AIR RELEASE VALVE IS BY OTHERS. SYSTEM CAN BE PIPED AS RAW WATER OR TREATED WATER REGENERATION.
- ALL PIPING MUST BE PROPERLY SUPPORTED AND BRACE TO HANDLE THE THRUST OF THE CHANGE OF WATER FLOW (BY OTHERS)
- GLASS FIBER REINFORCED THERMOPLASTIC DIAPHRAGM VALVES ARE SEQUENCED BY AN ELECTRONIC MULTIPORT STAGER. ELECTRICAL POWER REQUIRED - 120 VOLT, 1 PHASE, 60 Hz. MULTI-TANK SYSTEMS ARE SERIES REGENERATION.

- SYSTEM MUST BE INSTALLED TO COMPLY WITH ALL FEDERAL, STATE, PROVINCIAL AND LOCAL CODES.
- FLOOR DRAINS MUST BE SIZED TO CARRY THE MAXIMUM LISTED FLOW TO DRAIN.
- REFER TO THE INSTALLATION AND OPERATION MANUAL FOR FURTHER DETAILS.
- MEDIA BED CONSISTS OF NSF APPROVED BIRM MEDIA ON A GRADED SUPPORT BED
- IF OPTIONAL AIR DRAW SYSTEM USED THE SYSTEM MUST BE DESIGNED SO THE HYDROCHARGER BANK DRAWS AIR CONTINUOUSLY.

DBF SERIES BIRM
TRIPLEX FILTER SYSTEM

THIS DOCUMENT CONTAINS INFORMATION WHICH IS PROPRIETARY TO CANATURE WATERGROUP. THE REPRODUCTION, TRANSFER, OR OTHER EXPLOITATION OF ANY INFORMATION CONTAINED HEREIN IS NOT PERMITTED WITHOUT PRIOR WRITTEN APPROVAL OF CANATURE WATERGROUP. THE MANUFACTURER RESERVES THE RIGHT TO MAKE PRODUCT REVISIONS, WHICH MAY DEVIATE FROM THE SPECIFICATIONS AND DESCRIPTIONS STATED HEREIN WITHOUT OBLIGATION TO CHANGE PREVIOUSLY MANUFACTURED PRODUCTS OR TO NOTE THE CHANGE.



Project _____ Date 6/30/17 Rev _____
 Dwg # DBF 03 0